


Autonics Photoelectric Sensor BR SERIES (standard, short body)

INSTRUCTION MANUAL

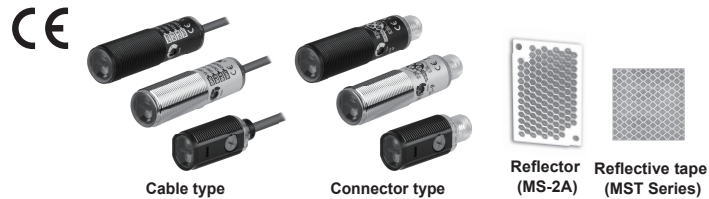

Thank you for choosing our Autonics product.
Please read the following safety considerations before use.

■ Safety Considerations

※ Please observe all safety considerations for safe and proper product operation to avoid hazards.
※ ⚠ symbol represents caution due to special circumstances in which hazards may occur.

⚠ Warning Failure to follow these instructions may result in serious injury or death.

⚠ Caution Failure to follow these instructions may result in personal injury or product damage.

⚠ Warning

- Fail-safe device must be installed when using the unit with machinery that may cause serious injury or substantial economic loss. (e.g. nuclear power control, medical equipment, ships, vehicles, railways, aircraft, combustion apparatus, safety equipment, crime/disaster prevention devices, etc.) Failure to follow this instruction may result in fire, personal injury, or economic loss.
- Do not disassemble or modify the unit. Failure to follow this instruction may result in fire.
- Do not connect, repair, or inspect the unit while connected to a power source. Failure to follow this instruction may result in fire.
- Check 'Connections' before wiring. Failure to follow this instruction may result in fire.

⚠ Caution


- Use the unit within the rated specifications. Failure to follow this instruction may result in fire or product damage.
- Use dry cloth to clean the unit, and do not use water or organic solvent. Failure to follow this instruction may result in fire.
- Do not use the unit in the place where flammable/explosive/corrosive gas, humidity, direct sunlight, radiant heat, vibration, impact, or salinity may be present. Failure to follow this instruction may result in fire or explosion.

■ Ordering Information

BR	P	5	M	-	T	D	T	-	A	-	C	-	P																																																											
<table border="1"> <tr> <td>Control output</td> <td>No mark</td> <td>NPN open collector output</td> </tr> <tr> <td></td> <td>P</td> <td>PNP open collector output</td> </tr> <tr> <td>Connection</td> <td>No mark</td> <td>Cable type</td> </tr> <tr> <td></td> <td>C</td> <td>Connector type</td> </tr> <tr> <td>Appearance</td> <td>A</td> <td>Standard</td> </tr> <tr> <td></td> <td>B</td> <td>Short body</td> </tr> <tr> <td>Emitter/Receiver</td> <td>1</td> <td>Emitter</td> </tr> <tr> <td></td> <td>2</td> <td>Receiver</td> </tr> <tr> <td>Output type</td> <td>T</td> <td>Transistor output</td> </tr> <tr> <td>Power supply</td> <td>D</td> <td>DC power</td> </tr> <tr> <td>Sensing type</td> <td>T</td> <td>Through-beam type</td> </tr> <tr> <td></td> <td>P</td> <td>Retroreflective type (built-in polarizing filter)</td> </tr> <tr> <td></td> <td>D</td> <td>Diffuse reflective type</td> </tr> <tr> <td>Sensing distance unit</td> <td>No mark</td> <td>mm</td> </tr> <tr> <td></td> <td>M</td> <td>m</td> </tr> <tr> <td>Sensing distance</td> <td>Number</td> <td>Sensing distance</td> </tr> <tr> <td>Case material</td> <td>S</td> <td>Stainless steel 316L</td> </tr> <tr> <td></td> <td>M</td> <td>Brass, Ni-plate</td> </tr> <tr> <td></td> <td>P</td> <td>Plastic</td> </tr> <tr> <td>Item</td> <td>BR</td> <td>Cylindrical type photoelectric sensor</td> </tr> </table>													Control output	No mark	NPN open collector output		P	PNP open collector output	Connection	No mark	Cable type		C	Connector type	Appearance	A	Standard		B	Short body	Emitter/Receiver	1	Emitter		2	Receiver	Output type	T	Transistor output	Power supply	D	DC power	Sensing type	T	Through-beam type		P	Retroreflective type (built-in polarizing filter)		D	Diffuse reflective type	Sensing distance unit	No mark	mm		M	m	Sensing distance	Number	Sensing distance	Case material	S	Stainless steel 316L		M	Brass, Ni-plate		P	Plastic	Item	BR	Cylindrical type photoelectric sensor
Control output	No mark	NPN open collector output																																																																						
	P	PNP open collector output																																																																						
Connection	No mark	Cable type																																																																						
	C	Connector type																																																																						
Appearance	A	Standard																																																																						
	B	Short body																																																																						
Emitter/Receiver	1	Emitter																																																																						
	2	Receiver																																																																						
Output type	T	Transistor output																																																																						
Power supply	D	DC power																																																																						
Sensing type	T	Through-beam type																																																																						
	P	Retroreflective type (built-in polarizing filter)																																																																						
	D	Diffuse reflective type																																																																						
Sensing distance unit	No mark	mm																																																																						
	M	m																																																																						
Sensing distance	Number	Sensing distance																																																																						
Case material	S	Stainless steel 316L																																																																						
	M	Brass, Ni-plate																																																																						
	P	Plastic																																																																						
Item	BR	Cylindrical type photoelectric sensor																																																																						

※ This information is intended for product management of through-beam type. (no need to refer when selecting model)

■ Operation Timing Diagram

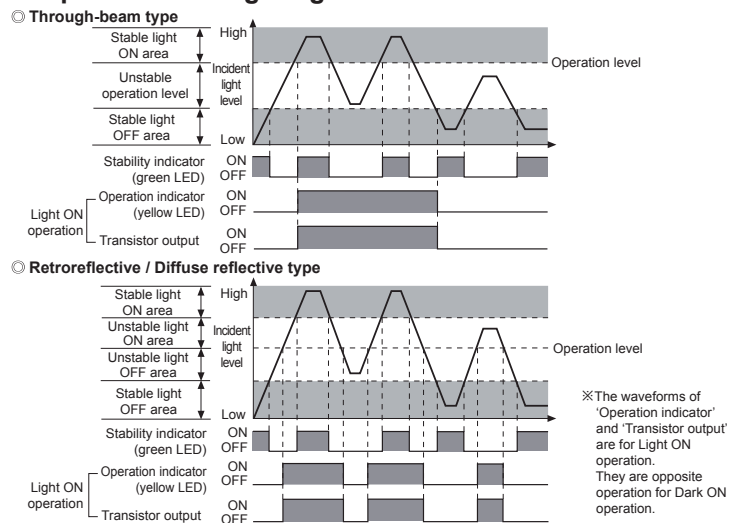



※ The above specifications are subject to change and some models may be discontinued without notice.
※ Be sure to follow cautions written in the instruction manual and the technical descriptions (catalog, homepage).

■ Specifications


Model	NPN open collector output BR_5M-TDT□□□□□□□□ PNP open collector output BR_5M-TDT□□□□□□□□-P	BR_20M-TDT□□□□□□□□	BR_30M-TDT□□□□□□□□	BR_3M-PDT□□□□□□□□	BR_100-DDT□□□□□□□□	BR_400-DDT□□□□□□□□	BR_1M-DDT□□□□□□□□	
Sensing type	Through-beam type			Retroreflective type (built-in polarizing filter)	Diffuse reflective type			
Sensing distance	5m	20m	30m	3m ^{*1}	100mm ^{*2}	400mm ^{*2}	1m ^{*3}	
Sensing target	Opaque materials of min. Ø7mm			Opaque materials of min. Ø75mm	Opaque, translucent materials			
Hysteresis	—							Max. 20% at rated sensing distance
Response time	Max. 1ms							
Power supply	10-30VDC=±10% (ripple P-P: max. 10%)							
Current consumption	Emitter/Receiver: max. 20mA Max. 30mA							
Light source	Red LED (660nm)			Infrared LED (850nm)	Red LED (660nm)			
Sensitivity adjustment	Sensitivity adjuster							
Operation mode	Selectable Light ON or Dark ON by control wire (white)							
Control output	NPN or PNP open collector output · Load voltage: max. 30VDC · Load current: max. 100mA · Residual voltage: max. 2VDC=							
Protection circuit	Power/Output reverse polarity protection circuit, output short over current protection circuit, interference prevention function (except through-beam type)							
Indicator	Operation indicator: yellow LED, Stability indicator: green LED (emitter power indicator of through-beam type: red LED)							
Connection	Cable type, connector type							
Insulation resistance	Over 20MΩ (at 500VDC megger)							
Noise immunity	±240V the square wave noise (pulse width: 1μs) by the noise simulator							
Dielectric strength	1,000VAC 50/60Hz for 1 minute							
Vibration	1.5mm amplitude at frequency of 10 to 55Hz in each X, Y, Z direction for 2 hours							
Shock	500m/s ² (approx. 50G) in X, Y, Z direction for 3 times							
Environment	Ambient illu.	Sunlight: max. 11,000lx, Incandescent lamp: max. 3,000lx (receiver illumination)						
	Ambient temp.	-25 to 60°C, storage: -30 to 70°C						
	Ambient humi.	35 to 85%RH, storage: 35 to 85%RH						
Protection structure	· BRP, BRM Series: IP67 (IEC standard) · BRS Series: IP67 (IEC standard), IP69K (DIN standard) · Case: BRP Series - Polycarbonate / BRM Series - Brass, Ni-plate / BRS Series - Stainless steel 316L · Lens, Lens cover: Polymethyl Methacrylate Acrylic							
Material								
Cable ^{*4}	Ø4mm, 4-wire, 2m (emitter of through-beam type: Ø4mm, 2-wire, 2m) (AWG26, core diameter: 0.52mm, number of cores: 20, insulator out diameter: Ø1mm)							
Accessory	Individual	Reflector (MS-2A)						
Approval	Common	M18 fixing nut: 4, adjustment screwdriver					M18 fixing nut: 2, adjustment screwdriver	
Weight ^{*5}	Cable type	BRP-A: Approx. 160g (approx. 110g) BRP-B: Approx. 150g (approx. 100g) BRM-A/BRS-A: Approx. 220g (approx. 140g)	BRP-A: Approx. 120g (approx. 60g) BRP-B: Approx. 120g (approx. 50g) BRM-A/BRS-A: Approx. 150g (approx. 70g)					
	Connector type	BRP-A: Approx. 110g (approx. 25g) BRP-B: Approx. 100g (approx. 20g) BRM-A/BRS-A: Approx. 160g (approx. 50g)	BRP-A: Approx. 110g (approx. 15g) BRP-B: Approx. 100g (approx. 10g) BRM-A/BRS-A: Approx. 140g (approx. 30g)					

※1: The sensing distance is specified with using the MS-2A reflector.
The distance between the sensor and the reflector should be set over 0.1m.
When using reflective tapes, the reflectivity will vary by the size of the tape. Please refer to the catalog or web site.
※2: Non-glossy white paper 100×100mm.
※3: Non-glossy white paper 300×300mm.
※4: M12 connector cable is sold separately.
※5: The weight includes packaging. The weight in parenthesis is for unit only.
※The temperature or humidity mentioned in Environment indicates a non freezing or condensation.


■ Dimensions

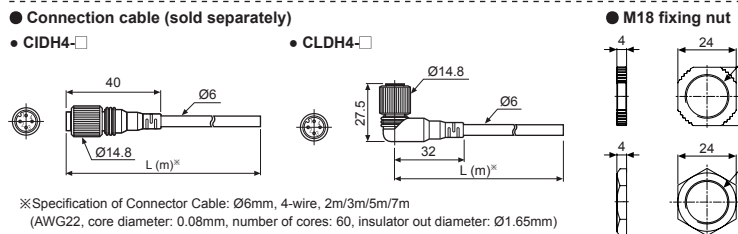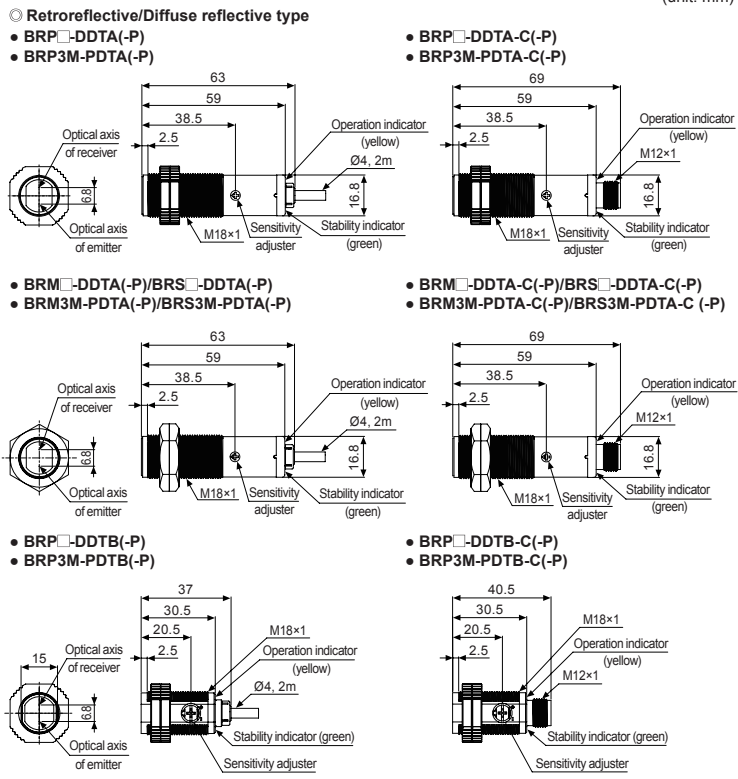


■ Connections

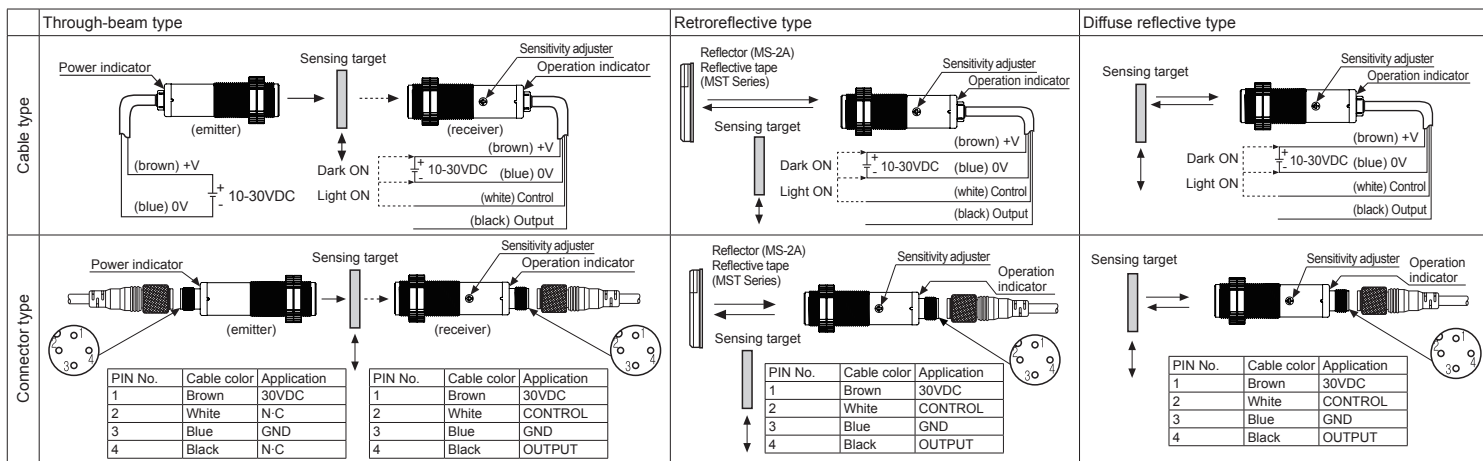

■ Control Output Circuit Diagram

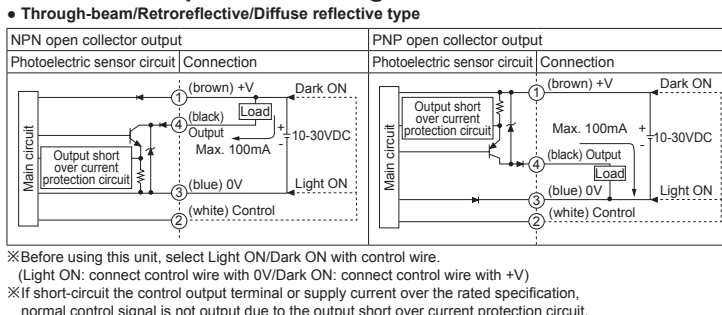

○ Through-beam type

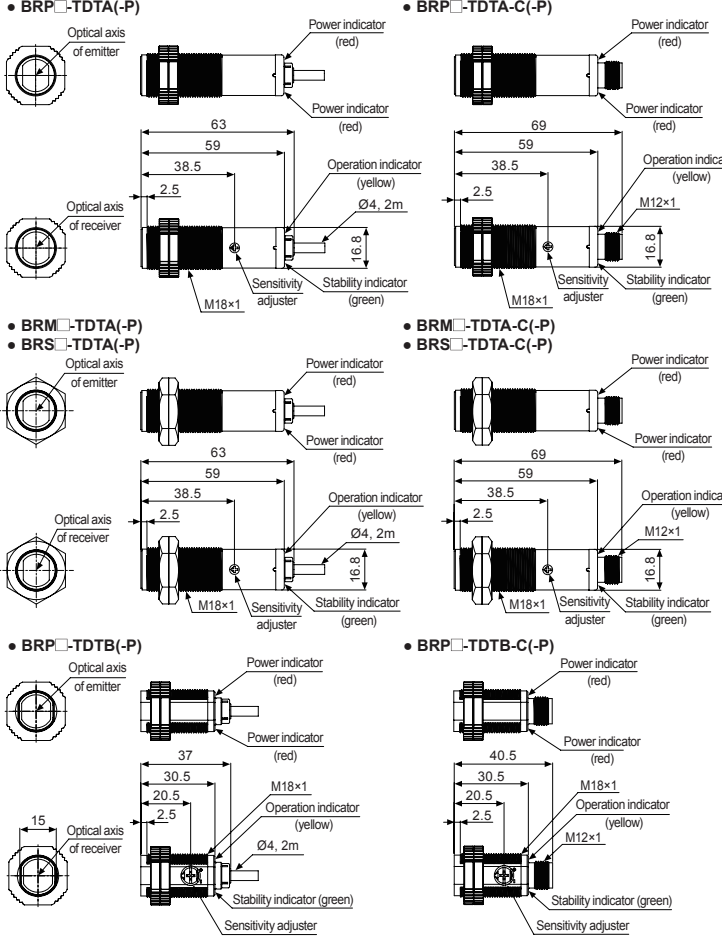


■ Installation and Sensitivity Adjustment

Install the sensor to the desired place and check the connections.
Supply the power to the sensor and adjust the optical axis and the sensitivity as following.
When using the reflective type photoelectric sensors closely over three units, it may result in malfunction due to mutual interference.
When using the through-beam type photoelectric sensors closely over two units, it may result in malfunction due to mutual interference.
When installing the product, tighten the screw with a tightening torque of 0.39N·m for BRP and to 14.7N·m for BRM/BRS.


○ Through-beam type

- Supply the power to the photoelectric sensor, after setting the emitter and the receiver facing each other.
 - Set the receiver in center of position in the middle of the operation range of indicator by adjusting the receiver or the emitter right and left, up and down.
 - After adjustment, check the stability of operation putting the object at the optical axis.
- ※ If the sensing target is translucent body or smaller than Ø7mm, it can be missed by sensor cause light penetrate it.




○ Retroreflective type

- Supply the power to the photoelectric sensor, after setting the photoelectric sensor and the reflector (MS-2A) or reflective tape in face to face.
 - Set the photoelectric sensor in the position which indicator turns on, as adjusting the reflector or the sensor right and left, up and down.
 - Fix both units tightly after checking that the unit detects the target.
- ※ Sensitivity adjustment: Refer to the diffuse reflective type's.



○ Diffuse reflective type

- The sensitivity should be adjusted depending on a sensing target or mounting place.
 - Set the target at a position to be detected by the beam, then turn the Sensitivity adjuster until position ① where the operation indicator turns ON from min. position of the Sensitivity adjuster.
 - Take the target out of the sensing area, then turn the Sensitivity adjuster until position ② where the operation indicator turns ON. If the indicator does not turn ON, max. position is ③.
 - Set the Sensitivity adjuster at the center of two switching position ①, ②.
- ※ Be sure that it can be different by size, surface and gloss to target.



■ Cautions During Use

- Follow instructions in 'Cautions during Use'. Otherwise, it may cause unexpected accidents.
- When connecting a DC relay or other inductive load to the output, remove surge by using diodes or varistors.
- Use the product, 0.5 sec after supplying power.
When using separate power supply for the sensor and load, supply power to sensor first.
- 10-30VDC power supply should be insulated and limited voltage/current or Class 2, SELV power supply device.
- Wire as short as possible and keep away from high voltage lines or power lines, to prevent inductive noise.
- When using switching mode power supply to supply the power, ground F.G. terminal and connect a condenser between 0V and F.G. terminal to remove noise.
- When using sensor with the equipment which generates noise (switching regulator, inverter, servo motor, etc.), ground F.G. terminal of the equipment.
- This unit may be used in the following environments.
① Indoors (in the environment condition rated in 'Specifications')
② Altitude max. 2,000m
③ Pollution degree 2
④ Installation category II

■ Major Products

- Photoelectric Sensors
- Fiber Optic Sensors
- Door Sensors
- Door Side Sensors
- Area Sensors
- Proximity Sensors
- Pressure Sensors
- Rotary Encoders
- Connectors/Sockets
- Switching Mode Power Supplies
- Control Switches/Lamps/Buzzers
- I/O Terminal Blocks & Cables
- Stepper Motors/Drivers/Motion Controllers
- Graphic Logic Panels
- Field Network Devices
- Laser Marking System (Fiber, CO₂, Nd: YAG)
- Laser Welding/Cutting System
- Temperature Controllers
- Temperature/Humidity Transducers
- SSRs/Power Controllers
- Counters
- Timers
- Panel Meters
- Tachometer/Pulse (Rate) Meters
- Display Units
- Sensor Controllers

Autonics Corporation
http://www.autonics.com

HEADQUARTERS:
10, Bansong-ro 513 beon-gil, Haeundae-gu, Busan, South Korea, 48002
TEL: 82-51-519-3232
E-mail: sales@autonics.com